


FAIRBANKS NIJHUIS™ MODEL 1800 & 1900

DIESEL ENGINE DRIVEN FIRE PUMP COOLING WATER PIPING DATA

Section 916 Page 301

Date April 2006

Supersedes Section 916 Page 301
Dated January 1997

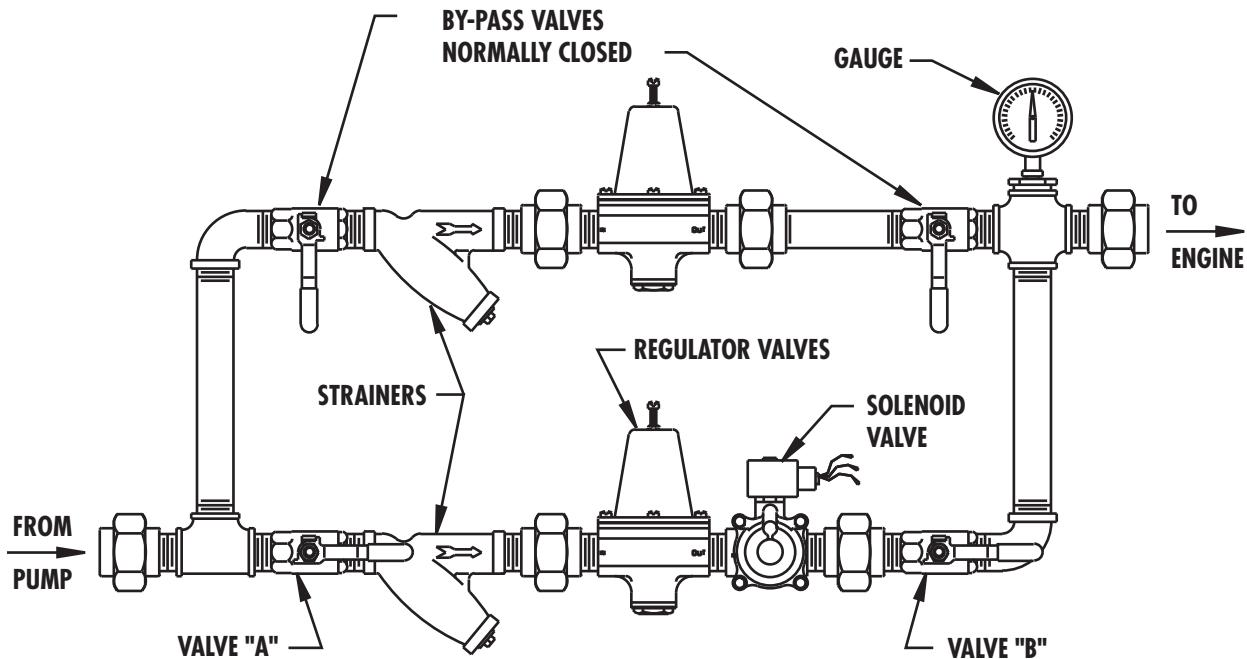

This instructional data explains the installation and operation of the cooling system for UL listed, FM approved Fire Pump engines equipped with heat exchangers.

Engines equipped with heat exchangers use an engine mounted water pump to circulate jacket water around the tubes of the heat exchanger to maintain proper jacket water temperatures. Cooling water, supplied by the Fire Pump, is piped through the tubes and discharged to waste.

REQUIREMENTS

The loop portion of the cooling water supply piping, shown above, incorporates all components required by NFPA and is sized to provide the required volume of water at the proper pressure for the heat exchangers of the engine models listed in Table A.

Model 1800 & 1900 pumps are shipped from the plant with the loop piped between the pump and engine. The pipe and loop sizes are determined by the engine model.

COMPONENTS

1. A flushing type strainer is used to protect the regulator valve, solenoid valve and the tubes of the heat exchanger from foreign material.
2. The regulator valve is used to control the volume and pressure of the cooling water.
3. The solenoid valve opens automatically when the engine is started and closes automatically on engine

shutdown to prevent the waste of cooling water. (One red wire must be connected to terminal #1 of the engine junction box, the other red wire to terminal #11 of the engine junction box, and the green wire grounded to the engine block. Refer to applicable wiring diagrams.)

4. The valves in the BYPASS line of the loop are normally CLOSED. They should ONLY be opened to provide cooling water to the engine if the regulator valve or solenoid valve require repair.
5. Valves "A" and "B" are normally OPEN. They should ONLY be closed if repair is required to the regulator valve or solenoid valve.

6. The gauge indicates back pressure on the cooling water discharge. The recommended back pressure to assure adequate flow is 15-20 PSI and should not exceed the allowable pressure shown in Table A.

7. Since cooling loop components are subject to bumps and movement during shipping, all components must be checked for pipe strain and leakage prior to initial startup.

INSTALLATION -COOLING WATER OUTLET

The cooling water outlet piping from the engine heat exchanger must be at least the size listed in Table A. The piping must be short, have no valves and discharge into an open waste cone. If deviations from the requirement of discharge to an open waste cone are permitted by the authority having jurisdiction, the proposed plumbing must be reviewed to assure that the back pressure created will not reduce the cooling water flow to below that required for the engine.



PENTAIR

FAIRBANKS NIJHUIS™